S

# **Notification Appliances**

**SET –** Mass Notification Speaker-Strobes Appliances **Applications:** Indoor/Outdoor



Clear-Lens Speaker Strobe – Wall Mount, Red (SET-CMC-R-MNS-ALERT)



FRI



Clear-Lens Speaker Strobe – Ceiling Mount (SET-CMC-CW-MNS-ALERT)

## **Product Overview**


- The Model SET-series of speaker-strobes is optionally compatible with a non-synchronized strobe appliance when connected directly to a ©UL2572 Listed mass-notification system, or can function with a synchronized strobe appliance when connected to a notification-appliance circuit running the Siemens sync protocol.
  - SET-series of speaker-strobes are @UL Listed for use with @UL2572 Listed mass-notification systems
  - SET-series speaker-strobes are designed for multiple power requirements with high dBA output at each power tap
  - The design incorporates a high-efficiency speaker for maximum output at minimum power across a frequency range of 400Hz to 4000Hz, and features a sealed-back construction for extra protection and improved audibility
  - Speaker-strobes offer a choice of field-selectable taps for 25 or 70 VRMS operation from 1/8 Watt to 8 Watts
  - Available with a CLEAR lens or AMBER-lens option:
    - Ceiling models are available with field-selectable, CLEAR-lens Candela settings of 15 / 30 / 75 / 95cd
    - Wall-mount models are available with field-selectable, CLEAR-lens Candela settings of 15 / 30 / 75 / 110cd
    - Ceiling models are available with field-selectable, AMBER-lens Candela settings of 11 / 22 / 56 / 71cd
    - Wall-mount models are available with field-selectable, AMBER-lens Candela settings of 11 / 22 / 56 / 82cd
    - Strobes can be synchronized using the Siemens DSC sync controls:
    - XLSM panel
    - PAD-series power supplies with built-in sync protocol
  - Only available with 'ALERT' text on the outside of each device
  - A speaker mounting plate is attached to the speaker for easier installation
  - Complies with Occupational Safety and Health Administration (OSHA) 29 Part 1910.165; Americans With Disabilities Act (ADA), and National Fire Protection Agency (NFPA 72)
  - Meets the requirements of the new NFPA 72 Chapter 24 (v2010) requirements for MNS applications of notification appliances

## **Specifications**

- Speaker-strobe appliances shall be Siemens Series SET Speaker Strobes or approved equals to be used with ©UL 2572 Listed mass-notification systems.


  - All models shall have listed sound output of up to 93dB at 10 feet and a listed frequency response of 400 to 4000 Hz
  - Speakers shall be designed for a field-selectable input of either 25 or 70 VRMS, with selectable power taps from 1/8 Watt to 8 Watts
  - Speaker shall incorporate a sealed-back construction
  - All inputs shall employ terminals that accept #12 to #18 American Wire Gauge (AWG) wire sizes
  - Strobe portion of the appliance shall produce a flash rate of one (1) flash per second, and shall incorporate a Xenon flashtube enclosed in a rugged Lexan<sup>®</sup> lens
  - Strobe shall be of low-current design
  - Selector switch for selecting the candela shall be tamper resistant
  - - XLSM panel
    - PAD-series power supplies with built-in, sync protocol
  - The strobes shall not drift out of synchronization at any time during operation
  - Strobes are available in AMBER and CLEAR lens, and devices for mass notification will have the word 'ALERT' appear on its cover in red text
  - Strobes shall revert to a non-synchronized flash-rate, if the sync module or power supply should fail to operate (i.e. – contacts remain closed)
  - Speaker-strobe appliances shall be designed for indoor / outdoor surfaces
  - Speaker-strobe shall incorporate a speaker-mounting plate with a grille cover, which is secured with two (2) screws for a level finish:
    - Grille cover shall mount to standard electrical hardware requiring no additional trim plate or adapter
  - All speaker-strobe appliances shall be listed for Special Applications:
    - Strobes are designed to flash at 1-flash-per-second minimum over their "Regulated Input Voltage Range"
    - Note: NFPA-72 specifies a flash rate of 1-to-2 flashes per second, and ADA Guidelines specify a flash rate of 1-to-3 flashes per second:

## Wiring Diagram

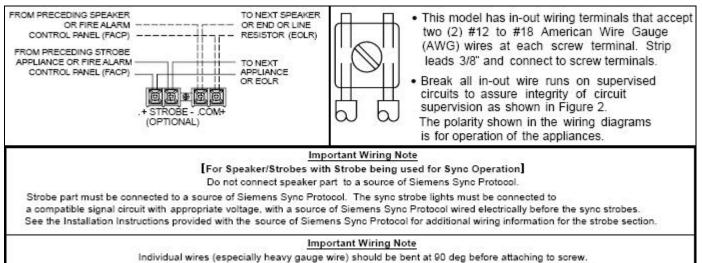


#### Wiring should then carefully be pushed back into back box to minimize stress on the terminal blocks.

## **Mounting Diagram**

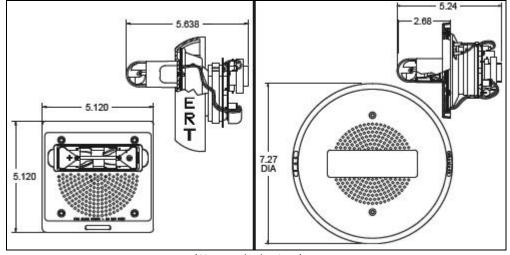

(Shown In Inches)

### Mounting Options

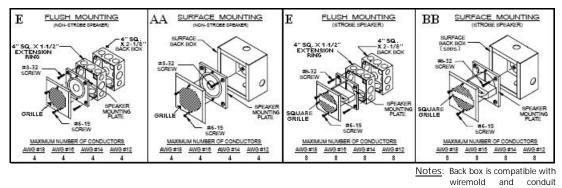

mountings. Knockout holes are for single-gang; double-gang; four-inch-square, 3-1/2" and 4" octagon <u>or</u> round backboxes.

## **Technical Data**

	Operating ®U	UL Listed Models and Ratings (Speaker)					Rat	ings	®UL Listed Models and Ratings (Strobe)			
	(Special Application) [Per ®UL 464]		dBA at 10 Feet (Rated Watts)					5 	Operating Voltage (Special Application) [Per  UL1971]	Voltage Range [Per  ULC- S526-02]	Strobe Candela (cd)	Strobe Candela (cd)
Models*	(VRMS)		1/4	1/2	1	2	4	8		(VDC/VRMS)	[Clear]	[Amber]
SET-C	25/70	75	78	81	84	87	90	93	16.0-33.0	20.0-31.0	15/30/75/95	11/22/56/71
SET	25/70	75	78	81	84	87	90	93	16.0-33.0	20.0-31.0	15/30/75/110	11/22/56/82

\*Available in red and white

**Notes:** 1. Models are **()**UL Listed for indoor / outdoor use with a temperature range of +32°F to +120°F (0°C to +49°C) and maximum humidity of 93% RH, non-condensing. The effect of shipping and storage temperatures shall not adversely affect the performance of the appliance when it is stored in the original cartons, and is not subjected to misuse or abuse.

2. The maximum supervision voltage is 33 Volts DC

3. Frequency range of speakers is 400 – 400Hz

CAUTION: Always operate audio amplifiers and speakers within their specified ratings. Excessive input may distort sound quality and may damage audio equipment. Do not exceed 100% of speaker input voltage per ©UL 1480. Improper input voltage can damage speaker. If distortion is heard, check for clipping of the audio appliance with an oscilloscope and reduce the amplifier input level or gain level to eliminate any clipping.

WARNING: Candela setting will determine the current draw of the product.

Position	25V	70V
A	8	
В	4	
С	2	
D	1	8
E	1/2	4
F	1/4	2
G	1/8	1
Н		1/2
		1/4

®UL	Voltage	15cd	30cd	75cd	95cd	
DC			0.111			
FWR	16-33VRMS	0.117	0.180	0.297	0.398	

OUL	Voltage	15cd	30cd	75cd	110cd	
DC			0.098	0.175	0.233	
FWR	16-33VRMS	0.108	0.164	0.268	0.368	

Note: Candela is measured on axis; Multi-Candela settings have been derated approximately 25% for Amber lens.

## **Details for Ordering**

Model	Part Number	Description	
SET-AMC-W-MNS-ALERT	S54301-Z75-A1	MNS Amber Speaker Strobe, multi Candela:	Wall Mount, White – 'ALERT'
SET-AMC-CW-MNS-ALERT	S54301-Z76-A1	MNS Amber Speaker Strobe, multi Candela:	Ceiling Mount, White – 'ALERT'
SET-AMC- <mark>R</mark> -MNS-ALERT	S54301-Z85-A1	MNS Amber Speaker Strobe, multi Candela:	Wall Mount, <mark>Red</mark> – 'ALERT'
SET-AMC-CR-MNS-ALERT	S54301-Z86-A1	MNS Amber Speaker Strobe, multi Candela:	Ceiling Mount, Red – 'ALERT'
SET-CMC-W-MNS-ALERT	S54301-Z95-A1	MNS Clear Speaker Strobe, multi Candela:	Wall Mount, White – 'ALERT'
SET-CMC-CW-MNS-ALERT	S54301-Z96-A1	MNS Clear Speaker Strobe, multi Candela:	Ceiling Mount, White – 'ALERT'
SET-CMC- <mark>R</mark> -MNS-ALERT	S54301-Z105-A1	MNS Clear Speaker Strobe, multi Candela:	Wall Mount, <mark>Red</mark> – 'ALERT'
SET-CMC-CR-MNS-ALERT	S54301-Z106-A1	MNS Clear Speaker Strobe, multi Candela:	Ceiling Mount, Red – 'ALERT'

**Notice:** This marketing data sheet is not intended to be used for system design or installation purposes. For the most up-to-date information, refer to each product's installation instructions.

Fire Safety 8 Fernwood Road Florham Park, NJ 07932 Tel: (973) 593-2600 FAX: (908) 547-6877 URL: www.usa.Siemens.com/Fire

(SII-FS) Printed in U.S.A. Fire Safety 1577 North Service Road East Oakville, Ontario L6H 0H6 / Canada Tel: [905] 465-8000 URL: <u>www.Siemens.CA</u>

October 2014 Supersedes sheet dated 8/2011 (Rev. 2)